


MODBUS CONTROLLER
(INSTALLER SUPPLIED)

A
B
24V
GND

TERMINATION JUMPER IN EN POSITION
IF LAST DEVICE IN NETWORK CHAIN

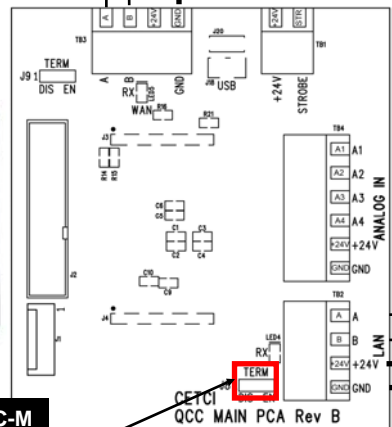

QCC-M

LINE VOLTAGE

TERMINATION JUMPER IN EN POSITION IF FIRST DEVICE IN NETWORK CHAIN

THREE RELAY CONTROL WIRING TERMINALS. CONNECT TO COM & NC. DO NOT USE SOLID CORE WIRE.

RELAYS OPERATE IN "FAIL SAFE" CONFIGURATON.



EARTH GROUND SHIELD NOT CONNECTED (if last device)

EARTH GROUND SHIELD (inside QCC enclosure)

INSTALLER SUPPLIED LINE VOLTAGE (90-240 VAC, 50-60 HZ)

QCC-RDM

QCC-RDM

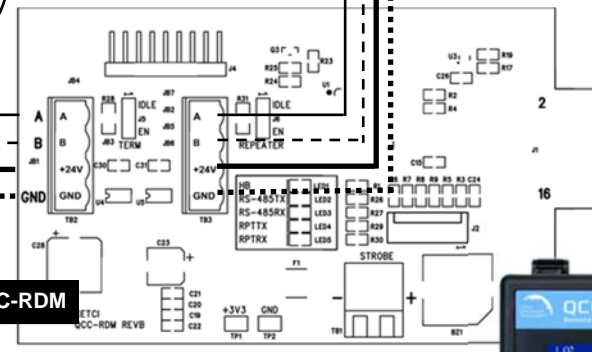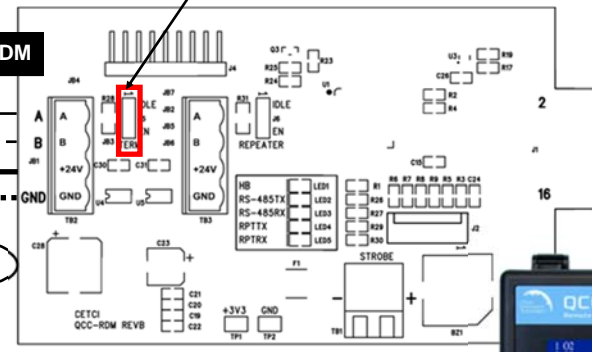

GND

CRITICAL ENVIRONMENT TECHNOLOGIES CANADA INC.
www.critical-environment.com

QCC-M TO TWO QCC-RDM WIRING CONNECTION DRAWING
REV-A August 18, 2016